




E-200 Series Universal Advanced Controller Quick Start Guide

Manufacturer / Technical Support :
Elimko Elektronik İmalat ve Kontrol Ltd. Şti.
ASO 2. Organize Sanayi Bölgesi Alcı OSB Mahallesi
2001. Cad. No:14 Temelli 06909 Ankara / TÜRKİYE
Tel: +90 312 212 64 50 (Pbx) • Fax: +90 312 212 41 43
E-mail: elimko@elimko.com.tr • www.elimko.com.tr




1. DESCRIPTION


E-200 Series general purpose process controllers are industrial devices in 1/4 DIN (96x96 mm IEC/TR 60668) dimensions designed by using new generation microcontrollers with on/off, PID and other control forms. Inputs and outputs can be easily programmed by the user.

In E-200 Series controllers, set value and measured value can be displayed from -1999 to 9999 on two 4-digit displays and general purpose inputs (T/C, R/T, mV, mA) can be programmed.

2. DIMENSIONS and PANEL CUT-OUT

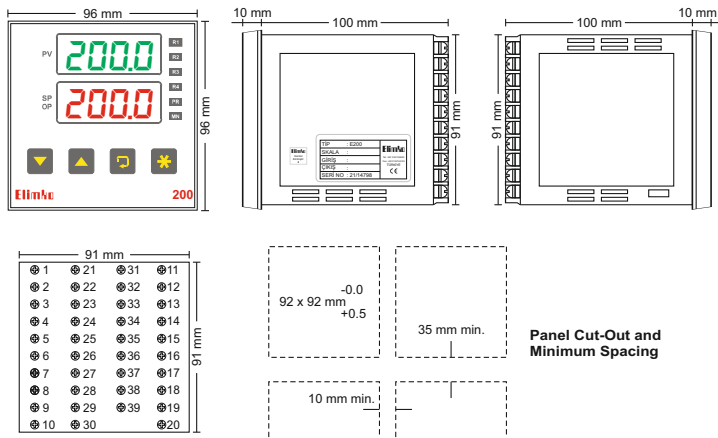


3. CONNECTION DIAGRAM

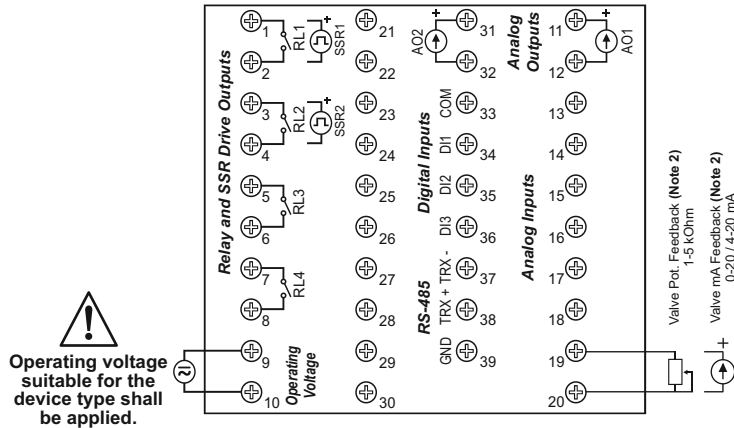

1st and 2nd control outputs can be selected as either Relay (RL1, RL2) or SSR (SSR1, SSR2).

Analog outputs (AO1, AO2) can be selected as either mA or 0-10 V DC.

Digital inputs are used by connecting a dry contact output between the COM terminal and the desired input (DI1, DI2 or DI3).

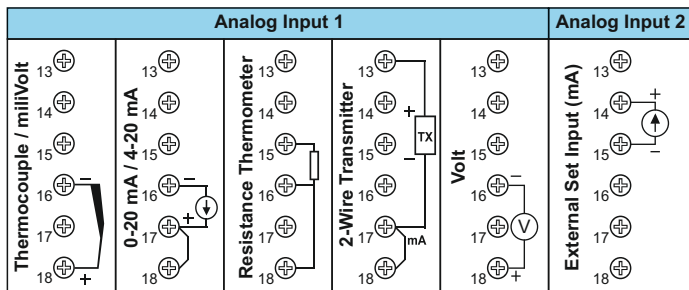

4. WARNINGS

E-200 controller is designed for panel mounting and should be used in an industrial environment.



- The package of E-200 controller contains; Controller, 2 pieces of mounting clamps, User manual and Guarantee certificate.
- After opening the package, please check the contents with the above list. If the delivered product is wrong type, any item is missing or there are visible defects, contact the vendor from which you purchased the product.
- Before installing and operating the controller, please read the user manual thoroughly.
- The installation and configuration of the controller must only be performed by a person qualified in instrumentation.
- Keep the unit away from flammable gases, that could cause explosion.
- Do not use alcohol or other solvents to clean the controller. Use a clean cloth soaked in water tightly squeezed to gently wipe the outer surface of the controller.
- It is not used in medical applications.

EU DIRECTIVE COMPLIANCE

Low Voltage Directive EN 61010-1
EMC Directive EN 61326-1



TS EN ISO 9001
Quality Management System Certificate

5. TYPE CODING

E-200 Series Universal Advanced Controller

E-200 - W X Y Z

Relay Outputs

- 2 relays (RL1, RL2)
- 3 relays (RL1, RL2, RL3)
- 4 relays (RL1, RL2, RL3, RL4)
- 1 SSR (SSR1) + 1 relay (RL2)
- 1 SSR (SSR1) + 2 relays (RL2, RL3)
- 1 SSR (SSR1) + 3 relays (RL2, RL3, RL4)
- 2 SSR (SSR1, SSR2) + 1 relays (RL3)
- 2 SSR (SSR1, SSR2) + 2 relays (RL3, RL4)

Analog Outputs *

- 1 x 0-20 / 4-20 mA (AO1)
- 2 x 0-20 / 4-20 mA (AO1, AO2)
- 1 x 0-10 V DC (AO1)
- 2 x 0-10 V DC (AO1, AO2)
- 1 x 0-20 / 4-20 mA (AO1) + 1 adet 0-10 V DC (AO2)

Communication

- None
- RS-485 **

Operating Voltage

- 85-265 V AC / 85-375 V DC
- 20-60 V AC / 20-60 V DC

* Analog outputs are isolated from each other.

** When E-200 Series devices are ordered with communication, the E-IB-11 USB-RS485 converter can be used for PC connection. There are various control and monitoring software provided by Elimko.

6. TECHNICAL SPECIFICATIONS

Parameter	Description
Control Type	On/Off, PID, Heat/Cool, Floating and Feedback Control of Valves
Operating Voltage	20..60 V AC / 20..60 V DC or 85..265 V AC / 85..375 V DC
Relays / SSR	4 Adet SPST - NO 250 V AC 5A relays or 24 V DC 25 mA (SSR) drives
Dimensions (mm)	96 (Length) x 96 (Height) x 100 (Width)
Panel Cut-Out (mm)	92 (Length) X 92 (Height)
Analog Output	2 x 0..20 / 4..20 mA or 0..10 V DC optional
Analog Input	Universal (Note 1), 1 x External set (mA)
Communication (RS-485)	Available (optional)
Digital Input	3 inputs
Valve Feedback	Available (Note 2)
Transmitter Supply	Available
Weight	430 g
Power Consumption	Max. 7 W (10 VA)
Operating Temperature	- 10 °C ... 55 °C
Storage Temperature	- 25 °C ... 65 °C
Memory	Maks. 100.000 write
Protection Class	IP-65 Front Panel, IP-20 Rear Case

Notes:

(1) Universal Input :

- Thermocouple : B, E, J, K, L, N, R, S, T, U
- Resistance Thermometer : Pt-100
- Current : 0-20 mA, 4-20 mA (Linear)
- Voltage : 0-50 mV, 0-1 V, 0.2- 1 V (Linear), 0-10 V DC, must be specified in the order.
- Resolution : 16 bit
- Accuracy : Thermocouple, Max. ±1.0 °C (Conversion and CJC error)
Resistance Thermometer, Max. ±0.5 °C (Conversion and wire resistance compensation)
Linear Input, Max. % 0.1

(2) Valve Feedback are supplied as potentiometer input in standard controllers. If the feedback type is requested as mA, it must be specified in the order.

7. PARAMETER TABLE

Description		Min	Maks	Unit
INPUT SETTINGS İÇİNF	İnP1	Analog Input 1 Type		
	dP	Decimal Point		
	5CLo	-199.9	999.9	EU
	5CHi	-199.9	999.9	EU
	Ünİt	°C	°F	
	o5L	-100.0	100.0	EU
	FLLr	1	15	s
	5nbr	Lo	Hi	
	İnP2	Analog Input 2 Type		
	52Lo	-199.9	999.9	EU
	52Hi	-199.9	999.9	EU
	52br	Lo	Hi	
	Rdr5	1	127	
bRİd	Modbus Baud Rate [48, 96, 192, 384 kbaud]			
Prİy	Modbus Parity [none, odd, Even]			

Description		Min	Maks	Unit
CONTROL SET SETTINGS 5ÇİP	5P5r	Control Set Point Source		
	5PLL	-199.9	5PHL	EU
	5PHL	-199.9	999.9	EU
	5Prr	oFF	60.0	EU/min
	5-1	5PLL	5PHL	EU
	İ-1	oFF	999.9	min
	5-2	5PLL	5PHL	EU
	İ-2	oFF	999.9	min
	5-3	5PLL	5PHL	EU
	İ-3	oFF	999.9	min
	5Eİ1	5PLL	5PHL	EU
	5Eİ2	5PLL	5PHL	EU
	5Eİ3	5PLL	5PHL	EU
5Eİ4	5PLL	5PHL	EU	


Description		Min	Maks	Unit
ALARM SETTINGS RİNF	RİtP	Alarm 1 Type		
	Rİ5P	-199.9	999.9	EU
	RİHY	0.0	999.9	EU
	Rİİt	d5b	Enb	
	R2tP	Alarm 2 Type		
	R25P	-199.9	999.9	EU
	R2HY	0.0	999.9	EU
	R2İt	d5b	Enb	
	R3tP	Alarm 3 Type		
	R35P	-199.9	999.9	EU
	R3HY	0.0	999.9	EU
	R3İt	d5b	Enb	
	R4tP	Alarm 4 Type		
	R45P	-199.9	999.9	EU
	R4HY	0.0	999.9	EU
	R4İt	d5b	Enb	

Description		Min	Maks	Unit
OUTPUTS oÇİNF	ÇİYP	Control Type		
	ÇİFr	dİr	rEu	
	ÇİPd	1	250	s
	nPr	d5b	Enb	
	İrİt	10	2500	s
	dbnd	0.1	25.0	%
	oİL	0.0	oHL	%
	oHL	oİL	100.0	%
	oİr	oİL	oHL	%
	PonÇ	0	4	
	İrLL	-199.9	İrHL	EU
	İrHL	İrLL	999.9	EU
	rLİd	Relay 1 Function		
	rL2d	Relay 2 Function		
	rL3d	Relay 3 Function		
	rL4d	Relay 4 Function		
	Roİd	Analog Output 1 Function		
	Roİr	Analog Output 1 Type		
	Ro2d	Analog Output 2 Function		
	Ro2r	Analog Output 2 Type		
SrUL	Feedback Valve Fully-Closed Position			
SrUH	Feedback Valve Fully-Open Position			

Description		Min	Maks	Unit
PID SETTINGS İLİNE	Rt	oFF	oN	
	Pİd	5İd	Rdİ	
	Pb-1	0.1	999.9	EU
	Pb-2	0.1	999.9	EU
	İtH	oFF	9999	s
	İtÇ	oFF	9999	s
	dİtH	oFF	2500	s
	dİtÇ	oFF	2500	s
HY5	0.0	999.9	EU	

Description		Min	Maks	Unit
SECURITY PrİÇ	5Çod	0	9999	
	dPrL	0	9	
	RPrL	0	9	
	FÇ5t	Factory Settings [oFF, LoRd, 5RİE, dFLt]		

8. ACCESSING PARAMETERS

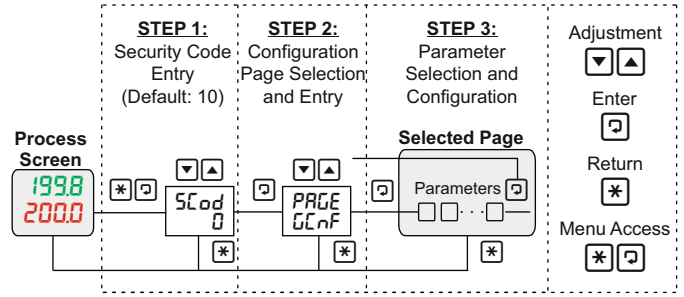

9. APPLICATION EXAMPLES

1) Input: Pt-100 Relay / Alarm1: 50 °C Low, Relay2 / Alarm2: 55 °C High
AO1: 4-20 mA PID Control Output

İnP1	RİtP	Rİ5P	R2tP	R25P	ÇİYP	rLİd	rL2d	Roİd	Roİr
Pt	Lo	500	Hi	550	5CLo	RL-1	RL-2	Lo-1	4-20

2) Input: TC Type J, Relay1: On-Off Control Output, Relay2 / Alarm2: 350 °C High

İnP1	R2tP	R25P	ÇİYP	rLİd	rL2d
J	Hi	3500	5CLo	do-1	RL-2

3) Input: TC Type K, Profile Control (Ramp up to 400°C in 10 minutes and wait for 60 minutes),
Relay1: PID Control Output, AO1: Retransmission Output (4-20 mA, 0-1200 °C)

İnP1	5P5r	5-1	İ-1	5-2	İ-2	ÇİYP	İrLL	İrHL	rLİd	rL2d	Roİd	Roİr
K	PrFL	400	İ00	400	600	5CLo	0	İ200	Lo-1	RL-2	Pİtr	4-20

4) Input: 4-20 mA, Scale: 0-600, External Set Point: 4-20 mA, Scale: 0-600,
Floating Valve Control (Travel Time 30 s), Relay1: Valve Open, Relay2: Valve Close

İnP1	5CLo	5CHi	İnP2	52Lo	52Hi	ÇİYP	İrİt	rLİd	rL2d
4-20	00	6000	4-20	00	6000	bnd	30	Lo-1	Lo-2

Table 1. Input Type Options

b	Type B Thermocouple
E	Type E Thermocouple
J	Type J Thermocouple
K	Type K Thermocouple
L	Type L Thermocouple
N	Type N Thermocouple
R	Type R Thermocouple
S	Type S Thermocouple
T	Type T Thermocouple
U	Type U Thermocouple
Pt	Pt-100
0-20	0-20 mA
4-20	4-20 mA
0-50	0-50 mV
00-1	0-1 V
02-1	0.2-1 V
0-10	0-10 V (*)
2-10	2-10 V (*)

(*) Custom specified volt input

Table 2. Control Set Options

İnt	Internal adjustment with keys
PrFL	With Profile Control
İrt	External adjustment with AIN2 external input
dİnP	With Digital Input

Table 3. Alarm Options

oFF	Off
Lo	Low Alarm
Hi	High Alarm
LoD	Low Deviation
HiD	High Deviation
LoB	Band Alarm (In)
HiB	Band Alarm (Out)

Table 4. Control Type Options

oFF	No Control
5CLo	Single (Heat)
dÇo	Double (Heat/Cool)
bnd	Floating Control of Valve
Pfb	Feedback Control of Valve

Table 5. Relay Output Options

Lo-1	PID + (Heating)
Lo-2	PID - (Cooling)
do-1	On-Off + (Heating)
do-2	On-Off - (Cooling)
RL-1	Alarm 1
RL-2	Alarm 2
RL-3	Alarm 3
RL-4	Alarm 4

Table 6. Analog Output Options

Lo-1	PID + (Heating)
Lo-2	PID - (Cooling)
Pİtr	Process Value
5P5r	Control Set Value

Table 7.1. Analog Output Range

0-20	0-20 mA
20-0	20-0 mA
4-20	4-20 mA
20-4	20-4 mA

Table 7.2. Analog Output Range

0-10	0-10 V
10-0	10-0 V
2-10	2-10 V
10-2	10-2 V

For detailed information, you can access the comprehensive user manual of the device under the heading "User Manuals" at www.elimko.com.tr. You can also use the QR Code on the front for this.